


**PLAN**

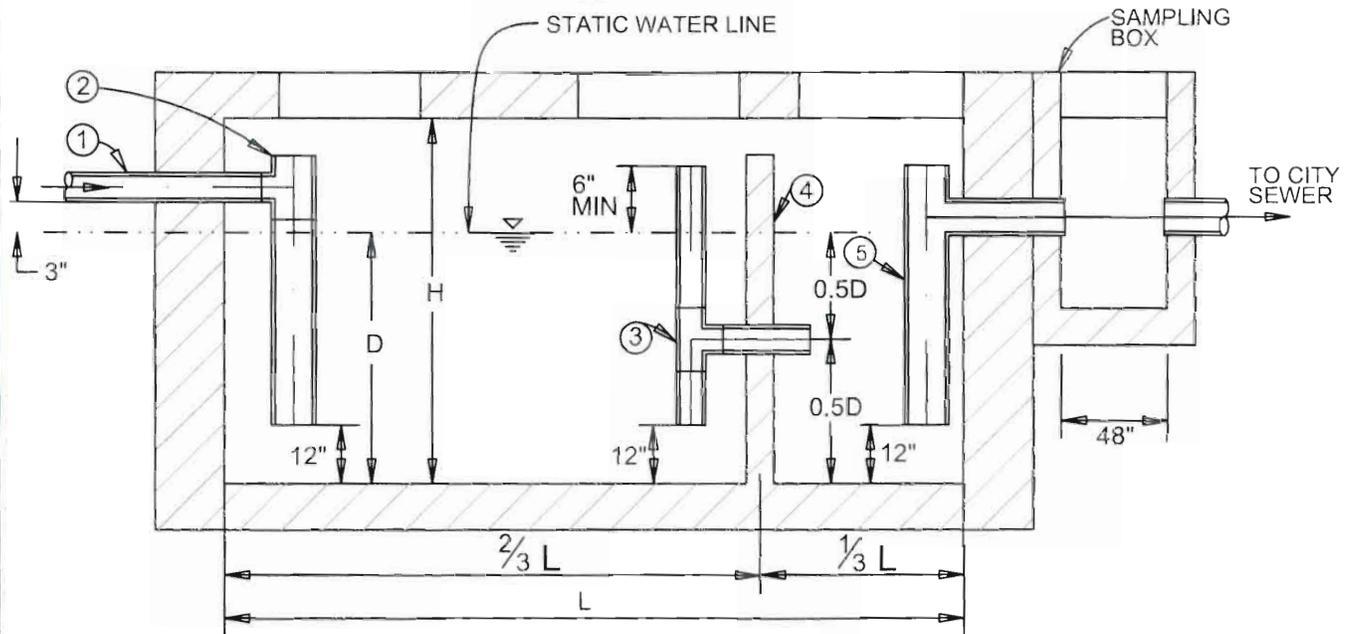

**SECTION A-A**

**NOTES:**

GREASE INTERCEPTOR SHALL BE DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS OF THE UNIFORM PLUMBING CODE, APPENDIX H. MINIMUM CAPACITY SHALL BE 750 GALLONS.

- ① INLET PIPE 4-INCH MINIMUM
- ② INFLOW TEE AND STANDPIPE
- ③ CROSSOVER TEE AND STANDPIPE
- ④ BAFFLE WALL
- ⑤ OUTFLOW TEE AND STANDPIPE



CITY OF BREA

**TYPICAL GREASE INTERCEPTOR**

APPROVED:

*Handwritten signature*  
CITY ENGINEER

DATE: 10-15-2013

STD. PLAN NUMBER

214-0

SHEET 1 OF 1