


CUT IN WYE

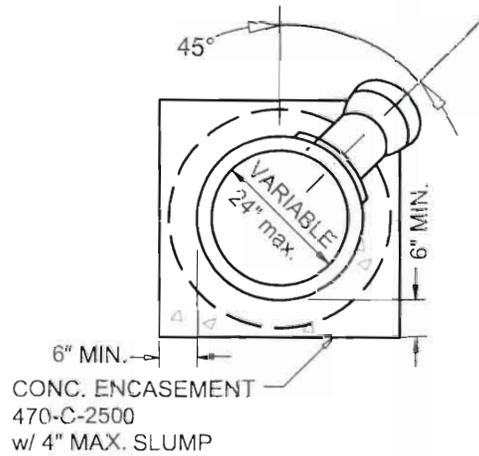

SECTION A-A

NOTES:

1. THE SADDLE CONNECTION SHALL BE SECURED WITH 470-C-2500 W/4" MAX SLUMP CONCRETE ENCASEMENT AFTER THE CONNECTION IS APPROVED BY THE CITY REPRESENTATIVE.
2. ALL CHIPS, DIRT, EPOXY, MORTAR, AND CONCRETE SHALL BE KEPT OUT OF THE SEWER.
3. DAMAGED PIPE SHALL BE REPLACED.
4. 8" AND LARGER CONNECTIONS SHALL BE BY STANDARD OR DROP MANHOLES.



CITY OF BREA

CUT IN WYE CONNECTION

APPROVED:

[Handwritten Signature]
CITY ENGINEER

DATE: 10-15-2013

STD. PLAN NUMBER

216-0

SHEET 1 OF 1