


COVER PLAN

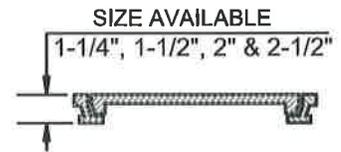

RISER RING

NOTES:

1. ADJUST CAP, FLUSH TO FINISHED STREET GRADE.
2. RISER PIPE MUST BE INSTALLED PLUMB AND SHALL BE CENTERED ON THE OPERATING NUT.
3. VALVE SIZE, STATION AND LOCATION SHALL BE SHOWN ON PLANS.
4. VALVE NUT EXTENSION IS REQUIRED IF VALVE NUT IS GREATER THAN 5' (FEET) BELOW SURFACE. VALVE NUT EXTENSION TO BE 2" (INCH) SQUARE AND 2' (FEET) TO 3' (FEET) BELOW SURFACE. EXTENSION SHALL BE EPOXIED ON THE OUTSIDE OF THE METAL.



VALVE BOX ASSEMBLY

APPROVED:

[Handwritten Signature]
CITY ENGINEER

DATE: 10-15-2013

STD. PLAN NUMBER

309-0

SHEET 1 OF 1