



PLAN VIEW

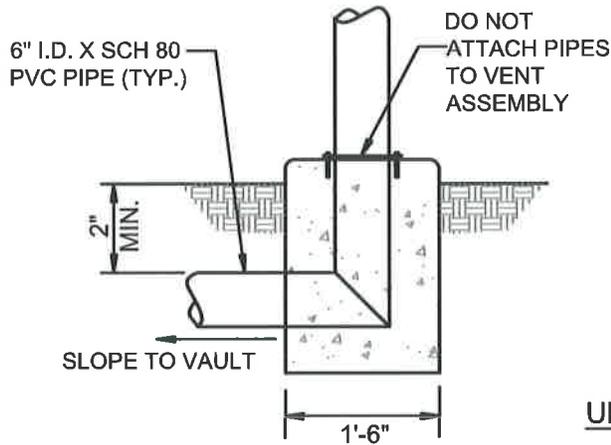

END VIEW

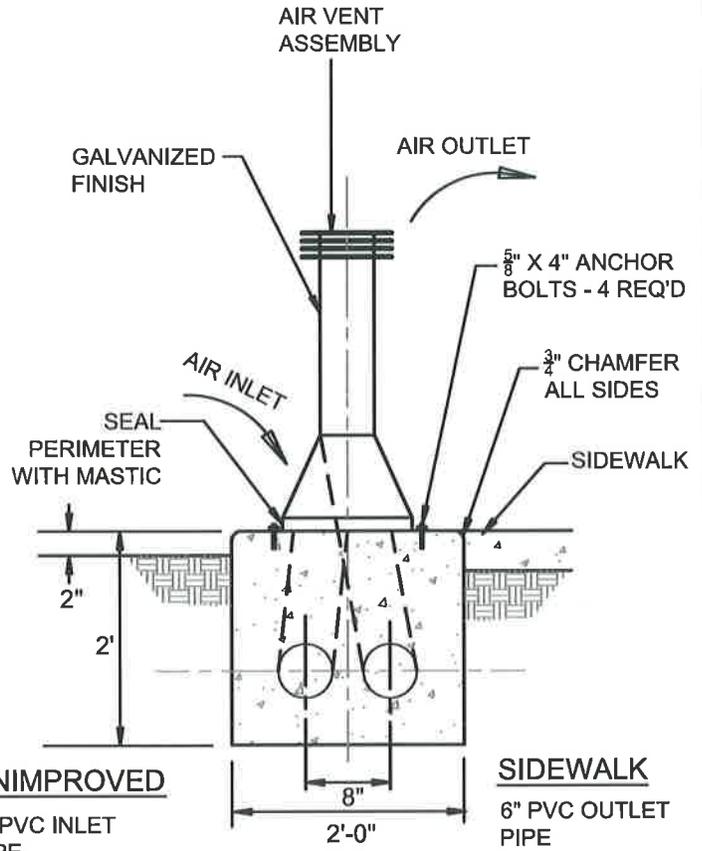

SIDE VIEW

TYPICAL INSTALLATION: SEE SHEET 2 FOR DETAILS

NOTES:

1. THIS AIR VENT SHALL BE INSTALLED AT ALL VAULTS CONSTRUCTED PER BREA STD PLAN 311 AND AS DIRECTED BY THE CITY ENGINEER.
2. THE LOCATION OF THE AIR VENT SHALL BE SPECIFIED ON THE IMPROVEMENT DRAWINGS.
3. TWO (2) - 6" I.D. X SCHEDULE 80 PVC PIPES SHALL BE INSTALLED INTO VAULT AND BOLTED TO SIDE WALL. AIR INLET PIPE SHALL BE INSTALLED TO 12" FROM VAULT FLOOR. AIR OUTLET PIPE SHALL BE INSTALLED ADJACENT TO VAULT ROOF.
4. BASE SHALL BE OF CLASS 470-C-2500 CONCRETE.



AIR VENT ASSEMBLY

APPROVED:



[Signature]
CITY ENGINEER

DATE: 10-15-2013

STD. PLAN NUMBER

318-0

SHEET 1 OF 2

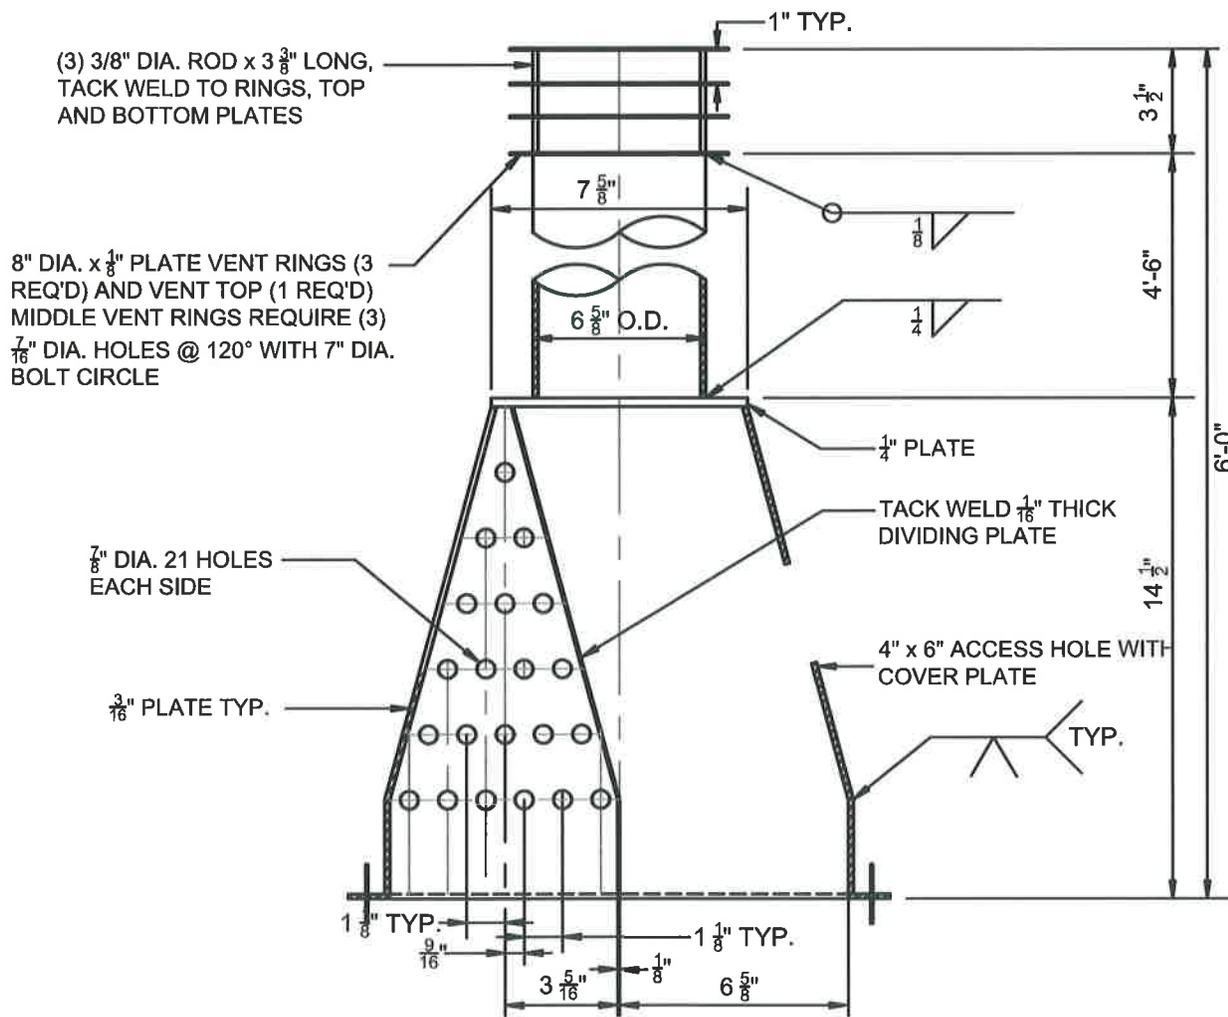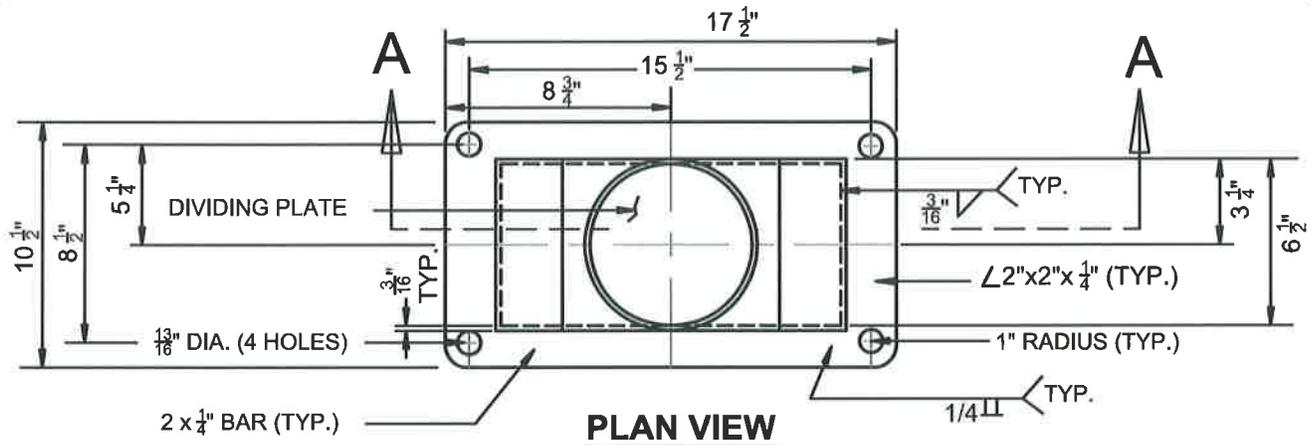

APPROVED:

[Signature]
CITY ENGINEER

DATE: 10-15-2013

AIR VENT ASSEMBLY

STD. PLAN NUMBER
318-0
SHEET 2 OF 2